



















GENERAL SPECIFICATIONS

- ALL MATERIALS AND EQUIPMENT SHALL BE INSTALLED AND COMPLETED IN FIRST CLASS WORKMANLIKE MANNER. ANY MATERIALS INSTALLED, WHICH SHALL NOT PRESENT AN ORDERLY AND REASONABLY NEAT OR WORKMANLIKE APPEARANCE, SHALL BE REMOVED AND REPLACED WHEN SO DIRECTED BY THE ARCHITECT/ENGINEER AT THE CONTRACTOR'S EXPENSE.
- NEW DUCTWORK SHOWN IS SCHEMATIC. PLAN ROUTING OF DUCTWORK AND COORDINATE LOCATION OF DUCTS AFTER INSPECTION OF EXISTING CONDITIONS AND BEFORE FABRICATION. SLIGHT VARIATION OF ROUTING AND/OR CONSTRUCTION SHOULD BE ANTICIPATED AND IS EXPRESSLY INCLUDED AS PART OF THE WORK WHENEVER REQUIRED, AT NO ADDITIONAL COST TO OWNER. IGNORANCE ON THE PART OF THE CONTRACTOR WILL IN NO WAY EXCUSE HIM OR SHE FROM THE OBLIGATIONS AND RESPONSIBILITIES OF THIS CONTRACT.
- ANY CONFLICTS OR DISCREPANCIES ON THESE DRAWINGS SHALL BE CALLED TO THE ATTENTION OF THE ARCHITECT/ENGINEER DURING THE BIDDING PERIOD FOR RESOLUTION. OTHERWISE, ALL SUCH CONFLICTS OR DISCREPANCIES SHALL BE RESOLVED AT THE CONTRACTOR'S EXPENSE.
- ALL CONTROL WIRING SHALL BE PROVIDED BY THE CONTRACTOR.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE COORDINATION WITH ALL OTHER TRADES FOR CLEARANCES AND USE OF AVAILABLE SPACE.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING AND PAYING FOR ALL PERMITS, FEES, INSPECTIONS AND TEST.
- THE CONTRACTOR SHALL FURNISH ALL LABOR, MATERIALS, EQUIPMENT AND SERVICES NECESSARY FOR THE INSTALLATION OF A COMPLETE MECHANICAL SYSTEM, READY FOR CONTINUOUS AND SATISFACTORY OPERATION BY THE OWNER.
- THE ENTIRE INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL CODES, INCLUDING ALL LOCAL RULES AND ORDINANCES.
- PROVIDE MANUAL VOLUME DAMPERS AT ALL DUCT TAKE-OFFS AND DIFFUSERS. DAMPERS SHALL BE MANUFACTURED ACCORDING TO SMACNA "HVAC DUCT CONSTRUCTION STANDARDS METAL AND FLEXIBLE" FIRST EDITION AND SHALL HAVE LOCKING QUADRANT WITH WING NUT.
- DUCTWORK MATERIAL
SUPPLY AIR DUCTWORK SHALL BE CONSTRUCTED OF FIVE POUNDS DENSITY 1-1/2" THICK GLASSFIBER (DESIGNED), CONSTRUCTED AND INSTALLED IN ACCORDANCE WITH SMACNA'S LOW PRESSURE DUCT MANUAL. ALL DUCT JOINTS SHALL BE SEALED AND TAPED.
- ALL EXHAUST DUCTWORK SHALL BE CONSTRUCTED OF GALVANIZED SHEET METAL, INSTALLED IN ACCORDANCE WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS METAL AND FLEXIBLE" FIRST EDITION.
- FLEXIBLE DUCTS SHALL BE UL LISTED CLASS 1 AIR DUCT. THERMAFLEX TYPE M-KE OR EQUAL. DUCTS SHALL BE INSTALLED IN ACCORDANCE WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS METAL AND FLEXIBLE" FIRST EDITION.
- DUCTWORK DIMENSIONS INDICATED, ARE INSIDE CLEAR AIR PASSAGE. ALL EQUIPMENT AND MATERIAL SHALL BE WARRANTEED FOR ONE YEAR AFTER DATE OF ACCEPTANCE BY THE OWNER.
- AIR DISTRIBUTION DEVICES SHALL BE OF ALL ALUMINUM CONSTRUCTION WITH TYPE #25 FINISH. ALL DIFFUSERS, REGISTERS AND GRILLS SHALL HAVE OPPOSED BLADE DAMPERS IN THROAT OR NECK. MANUFACTURER SHALL BE METALAIR OR PRE-APPROVED EQUAL.
- REFRIGERANT LINES SHALL BE TYPE "L" SOFT DRAWN, COPPER TUBING DEHYDRATED FOR REFRIGERANT USE. SIZE SHALL BE SHOWN ON DRAWINGS OR AS PER MANUFACTURERS RECOMMENDATION.
- REFRIGERANT LINE INSULATION SHALL BE 1" FDM PLASTIC INSULATION (R-4), FIRE RETARDANT TYPE. SEAL JOINTS WITH MANUFACTURERS APPROVED ADHESIVE. INSULATION SHALL HAVE A EXTERNAL PERMEANCE NOT EXCEEDING 0.05 PERM WHEN TESTED.
- THE INSIDE OF ALL VISIBLE DIFFUSERS SHALL BE PAINTED BLACK.
- A/C CONTRACTOR TO INCLUDE 1 YEAR MAINTENANCE OF THE SYSTEM.
- DRYER EXHAUST DUCTWORK SHALL BE CONSTRUCTED OF GALVANIZED SHEET METAL MINIMUM DUCT THICKNESS OF 0.016 INCHES (26 GAGE), INSTALLED IN ACCORDANCE WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS METAL AND FLEXIBLE" FIRST EDITION.
- PROVIDE BACKDRAFT DAMPERS AT ALL EXHAUST DUCTWORK.
- CONDENSATE RISERS SHALL BE CONSTRUCTED OF SCHEDULE 40 PVC. CONDENSATE LINES INSIDE OF AC CLOSET SHALL BE CONSTRUCTED OF TYPE "L" COPPER.
- THE CONTRACTOR SHALL CAREFULLY REVIEW AND VERIFY THE MECHANICAL DRAWINGS AND SPECIFICATIONS IN ADDITION TO OTHER RELATED TRADES AND SECTIONS. SHOULD ANY DISCREPANCIES BE FOUND THE ARCHITECT/ENGINEER MUST BE NOTIFIED. THIS COORDINATION SHALL BE DONE PRIOR TO SUBMITTING THE BID.

DOUBLE LINE

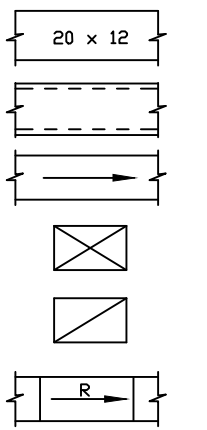

A/C SYMBOL LEGEND

DUCT (1ST. DIMENSION, SIDE SHOWN; 2ND. DIMENSION, SIDE NOT SHOWN)

ACOUSTICAL LINING (DUCT DIMENSIONS FOR NET FREE AREA)

DIRECTION OF FLOW

DUCT SECTION UP OR DOWN (SUPPLY)

DUCT SECTION UP OR DOWN (EXHAUST OR RETURN)

INCLINE RISE (R) OR DROP (D) ARROW IN DIRECTION OF AIR FLOW.

TRANSITIONS

STANDARD BRANCH FOR SUPPLY & RETURN (NO SPLITTER)

SPLITTER DAMPER

VOLUME DAMPER (MANUAL OPERATION)

AUTOMATIC DAMPERS (MOTOR OPERATED)

ACCESS DOOR (AD), ACCESS PANEL (AP)

FIRE DAMPER IN VERTICAL DUCT / IN HORIZONTAL DUCT

SMOKE DAMPER & RADIANT DAMPER

DYNAMIC MOTORIZED DAMPER

BACK DRAFT DAMPER

CEILING DIFFUSER, SQUARE

CEILING DIFFUSER, RECTANGULAR

CEILING DIFFUSER, ROUND

SMOKE DETECTOR, DUCT MOUNTED

EXHAUST FAN, CEILING MOUNTED

RETURN AIR GRILLE, CEILING MOUNTED














THERMOSTAT

HUMIDISTAT

CO² SENSOR

CENTRIFUGAL EXHAUST FAN ROOF MOUNTED

SINGLE LINE

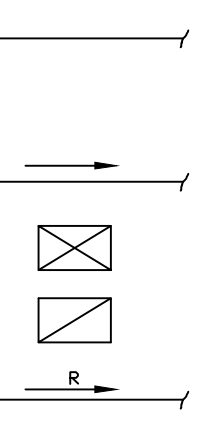


NOTE : THESE ARE STANDARD SYMBOLS AND MAY NOT ALL APPEAR ON PROJECT DRAWINGS

| HVAC DESIGN REQUIRES: | YES | NO |
|----------------------------------------|-----|----|
| DUCT SMOKE DETECTOR | | ✓ |
| FIRE DAMPER(S) | | ✓ |
| SMOKE DAMPER(S) | | ✓ |
| FIRE RATED ENCLOSURE | | ✓ |
| FIRE RATED ROOF/FLOOR CEILING ASSEMBLY | | ✓ |
| FIRE STOPPING | | ✓ |
| SMOKE CONTROL | | ✓ |

AIR DISTRIBUTION SCHEDULE

| SYM | USE | TYPE | ACCESSORIES | NECK SIZE | CFM | MFR & MODEL NO |
|-----|--------|--------|-------------|-----------------------------|----------------------------------------|-----------------------|
| A | SUPPLY | GRILLE | OBD | 8x4 10x6 12x8 16x8 | 0-100 101-200 201-300 301-400 | METAL AIRE V4002-1 |

- NOTES:
1. CONTRACTOR TO PROVIDE ROUND TO SQUARE NECK TRANSITION.
2. CONTRACTOR SHALL COORDINATE ALL DIFFUSERS WITH CEILINGS.

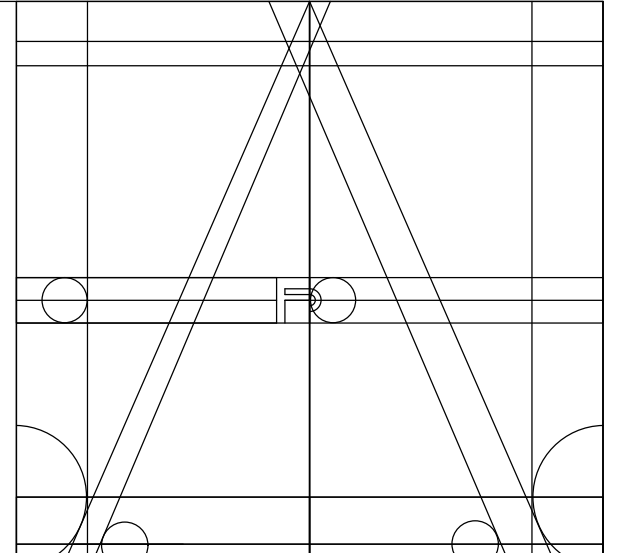

ANA STUDIO ARCHITECTURE, PC
ANA RESKREIS, RA
280 RIVERSIDE DRIVE, 8th FLOOR, NEW YORK, N.Y. 10025
+1 212 644 3410 +1 212 438 24 33
ANASTUDIO@GMAIL.COM
WWW.FRENGEDESIGN.COM

WEXLER RESIDENCE
300 SOUTHPOINTE DR.
4304

MIAMI BEACH, FL.
33139

NOTES

| No. | Date | Description |
|-----|------|-------------|
| | | |
| | | |
| | | |
| | | |

TITLE

| DATE | 12.12.2023 |
|-------------|------------|
| PROJECT No. | |
| DRAWN BY: | |
| CHECKED BY: | |
| DRG No. | |

Fine Line Engineers Inc.
Electrical, Mechanical, Plumbing
Fire Protection, Construction Administration
2089 W. 76TH STREET Hialeah, FL 33016
Voice 786.953-4901 - Fax 786.953-4907
E-mail: gfrejo@fineengineers.com
GEORGE FREJO, P.E.
REGISTERED ENGINEER NO. 33278
STATE OF FLORIDA, Exp. 2/27/26